



WILLIAMSON COUNTY

Leslie Mitchell, CPPO, CPPB
1320 West Main Street, Suite 130
Franklin, Tennessee 37064
(615) 790-5868
lesliem@williamson-tn.org

August 28, 2015

Addendum #1 to Kitchen Equipment Bid
For Public Safety Facility
RFP Opening Date September 24, 2015

Following are questions received regarding the above bid:

RE: gas equipment, will you be supplying the gas connector hose? If not, what length do you need?

RE: hot and cold food counters, do you have a floor receptacle with the correct NEMA configuration? Is there a floor drain within six feet of the unit, or will you drain into a bucket?

RE: Ice makers, is there electrical connection, water connection and floor drain within six feet of the unit? Will the water filter connect to the ice maker or a wall in close proximity?


The questions are answered on the attached drawings.



Leslie Mitchell, CPPO, CPPB, Purchasing Agent

LM/lw

RESPONSES TO PLUMBING-RELATED QUESTIONS:

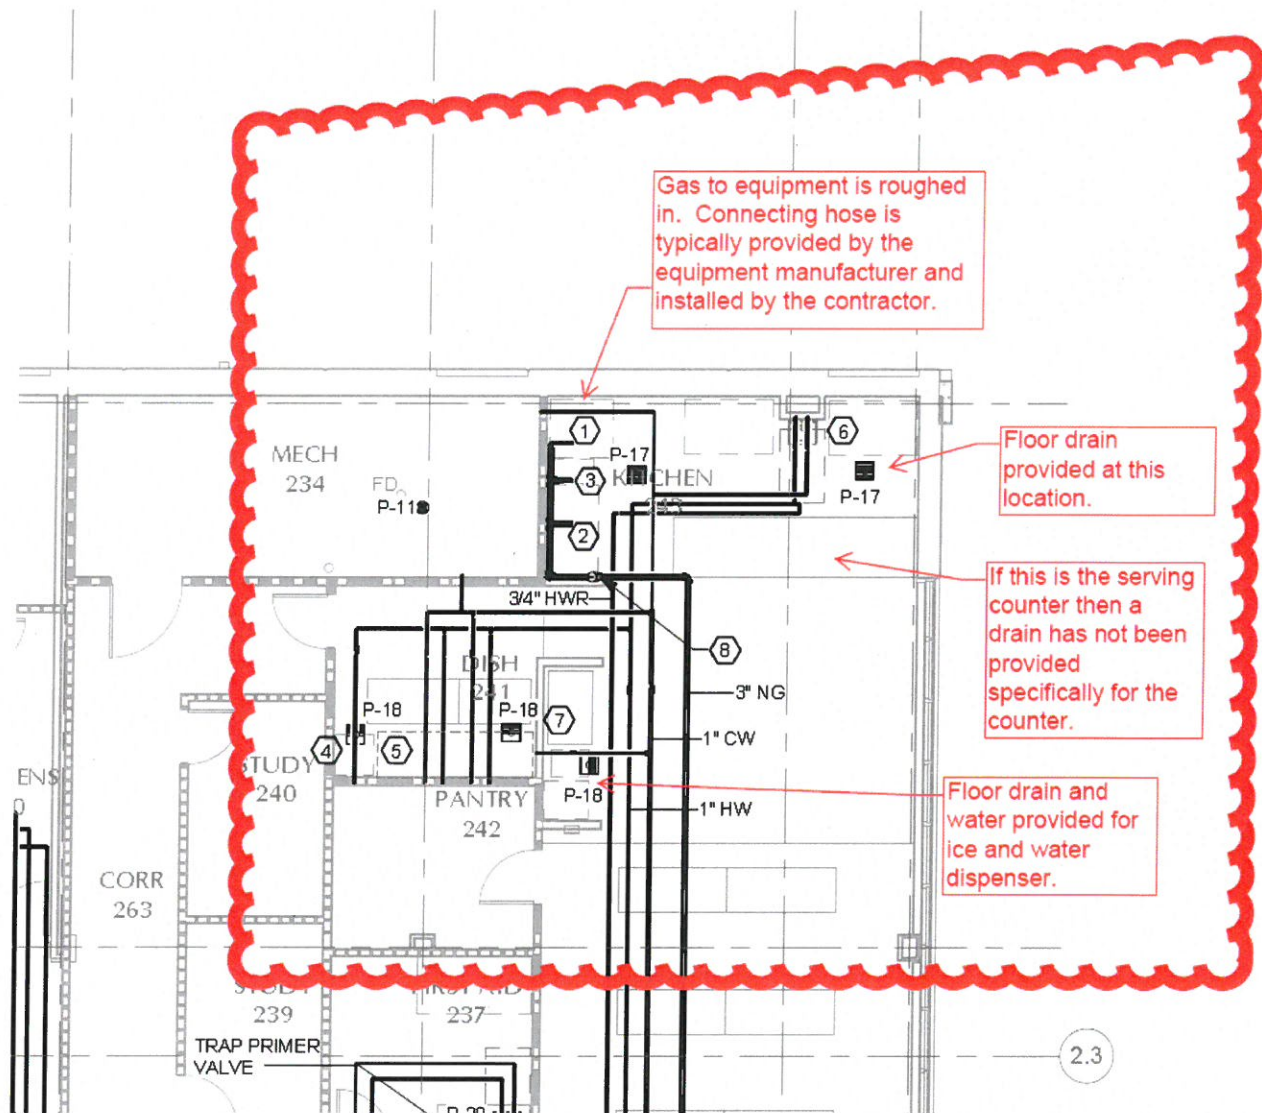

RESPONSES TO ELECTRICAL-RELATED QUESTIONS:

Assuming this is the Hot/Cold food counters, No floor receptacles, and this wall mounted outlet was intended to be used for that. However, we do not know what the correct NEMA configuration is needed, this needs to be coordinated with the electrical contractor.

